



+

Figure 1A


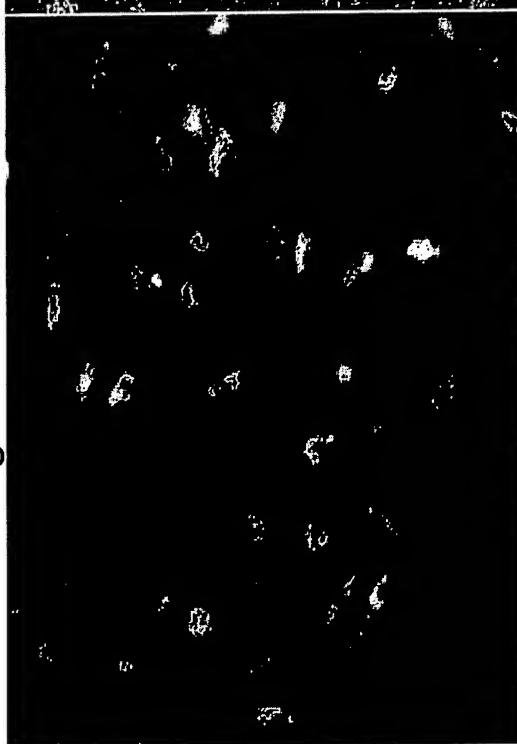


Figure 1B



(1/20)

Figure 1C

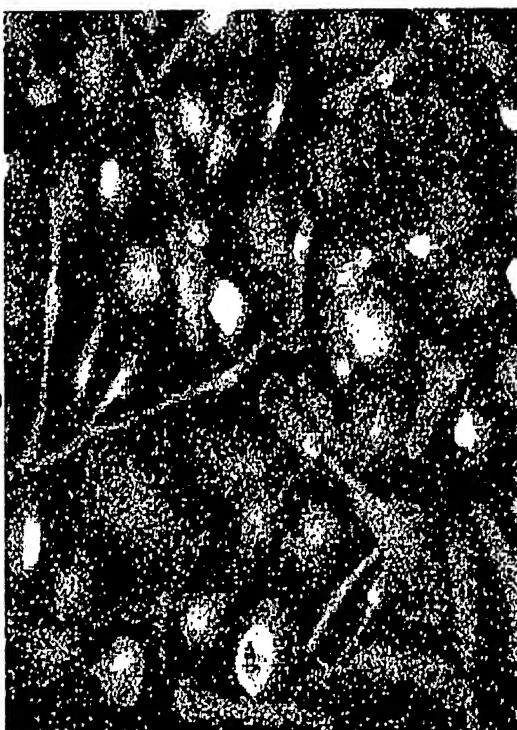

+

Replacement Sheet

Figure 2



+

(6/20)

Figure 6A


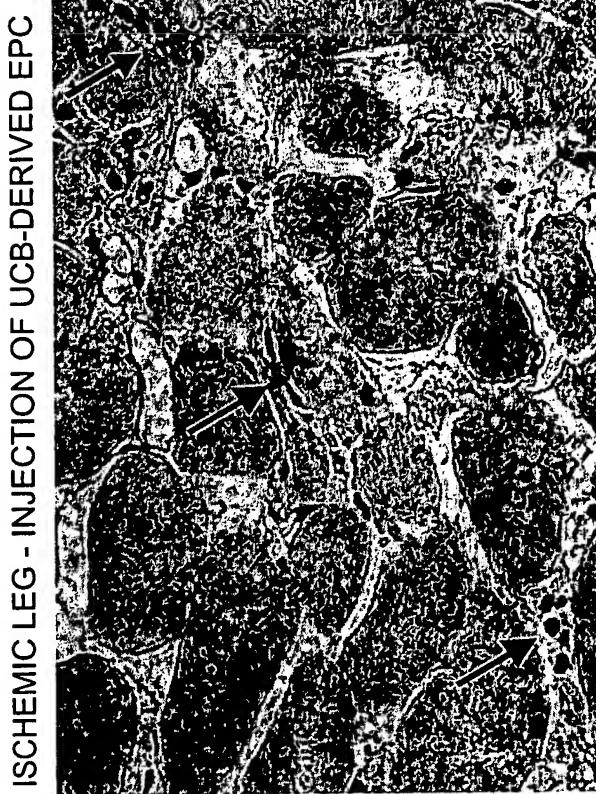


Figure 6B

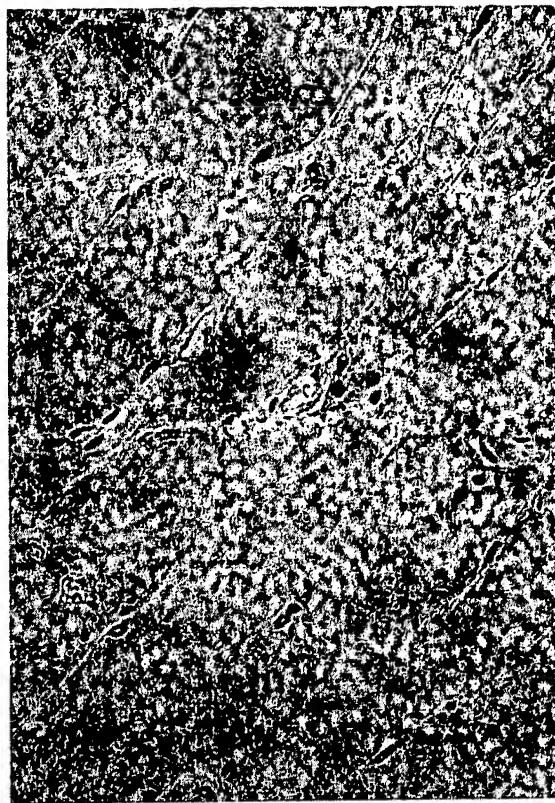

+

Replacement Sheet

Figure 13

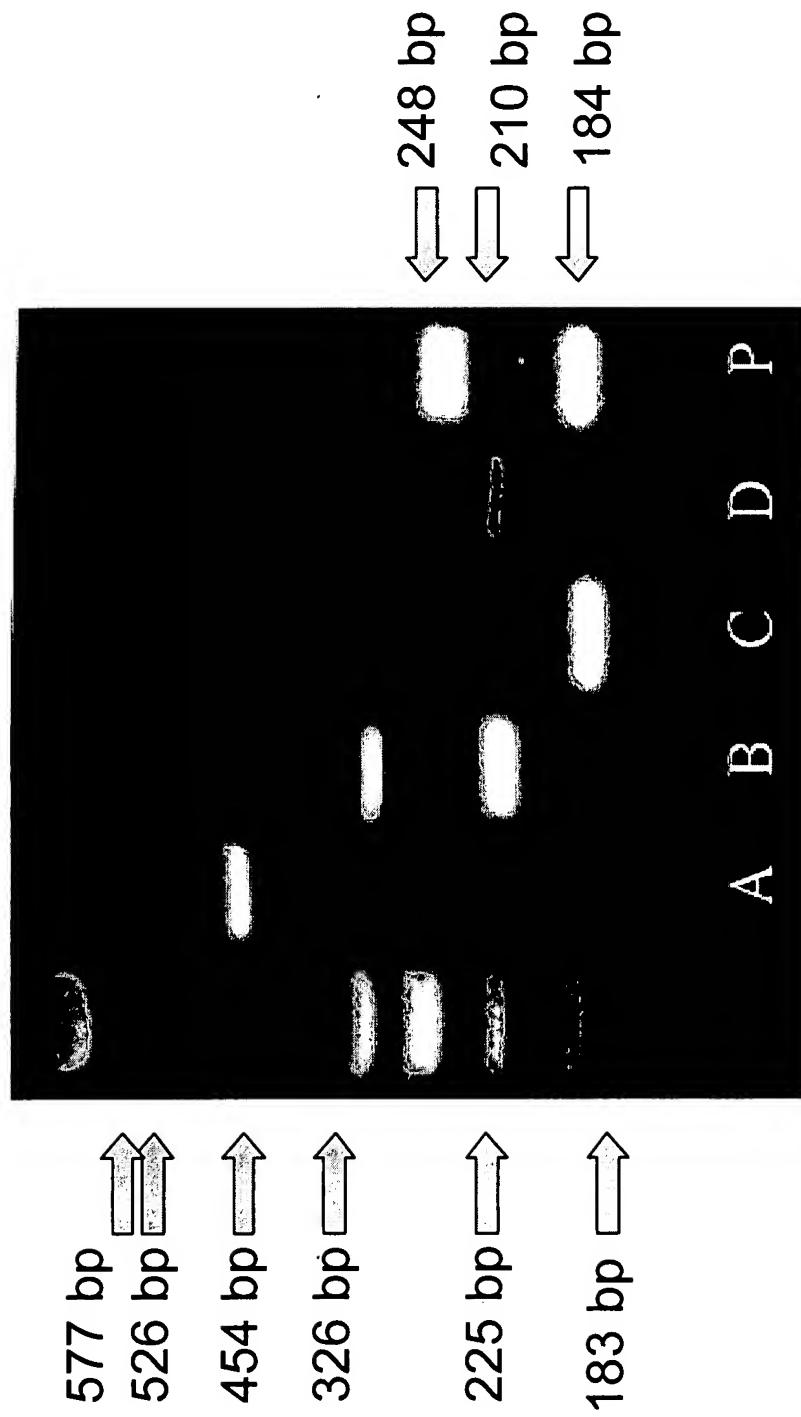


Figure 14

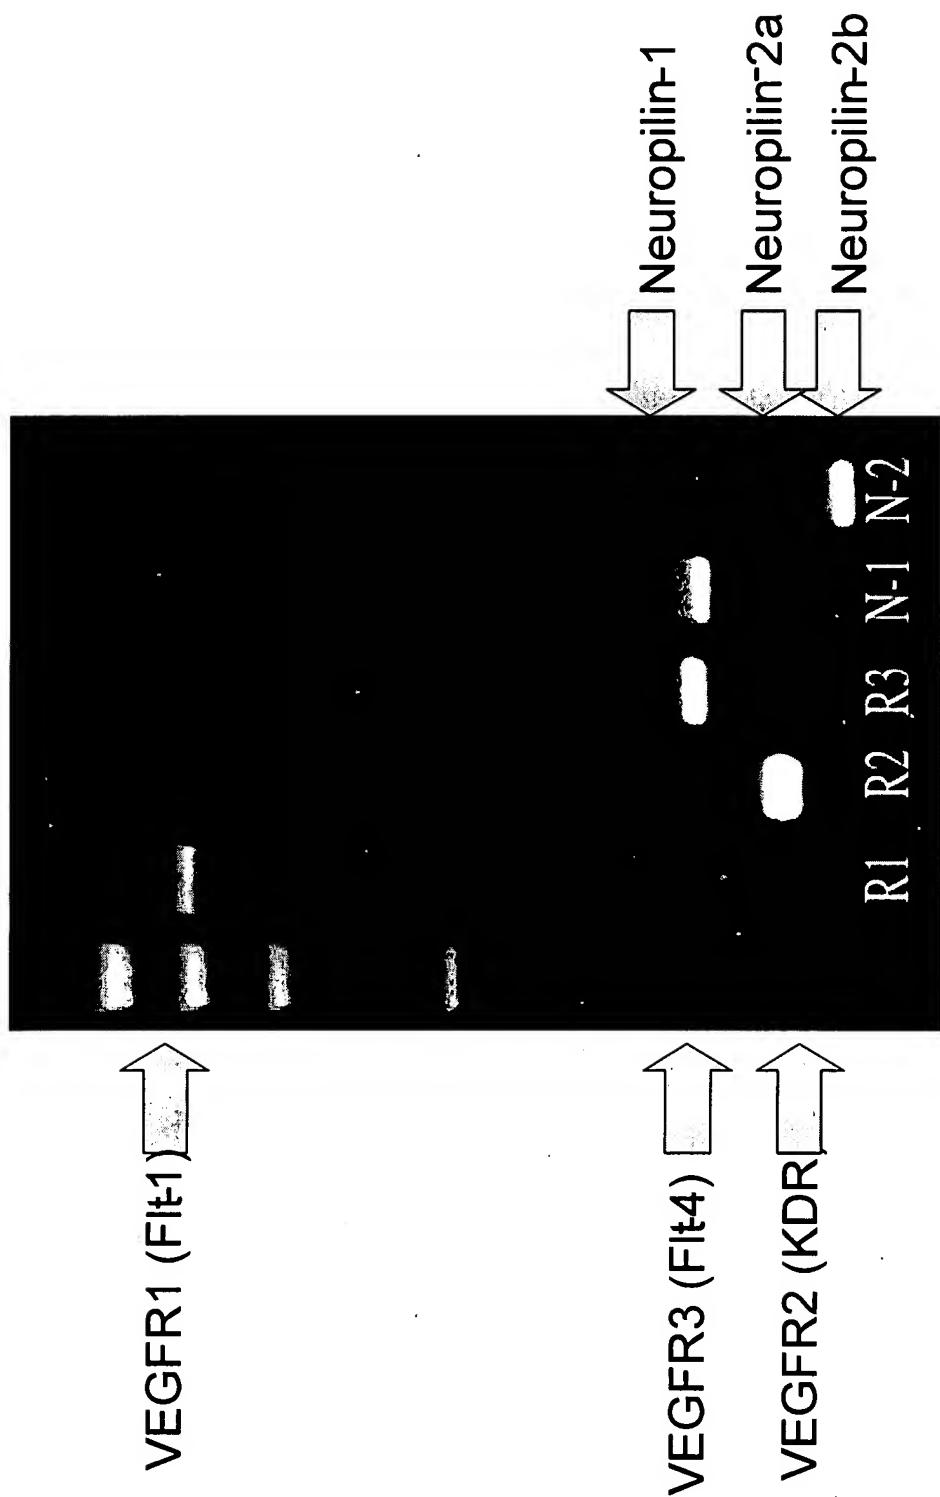


Figure 16A
HUVECs ON 1% GELATIN COATED PLATE.

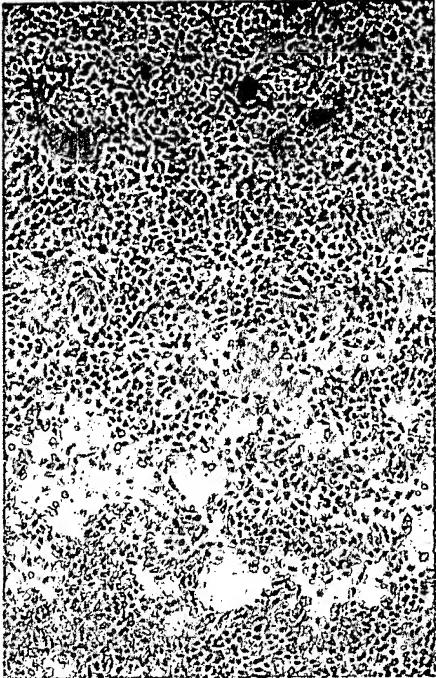


Figure 16B
HUVECs IN VITROGEN3D COLLAGEN GEL



Figure 16C
DIL STAINED hMSCs 1 HOUR AFTER
ADDITION TO HUVECs IN 3D COLLAGEN GEL

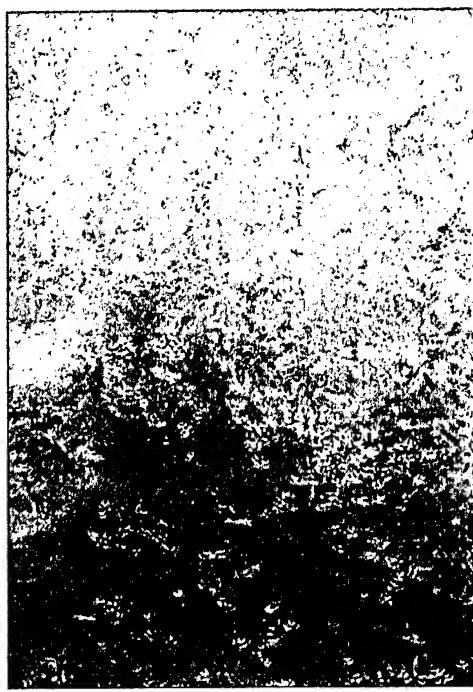



Figure 16D
DIL STAINED hMSCs 72 HOURS AFTER
ADDITION TO HUVECs IN 3D COLLAGEN GEL



(16/20)

+

Figure 18

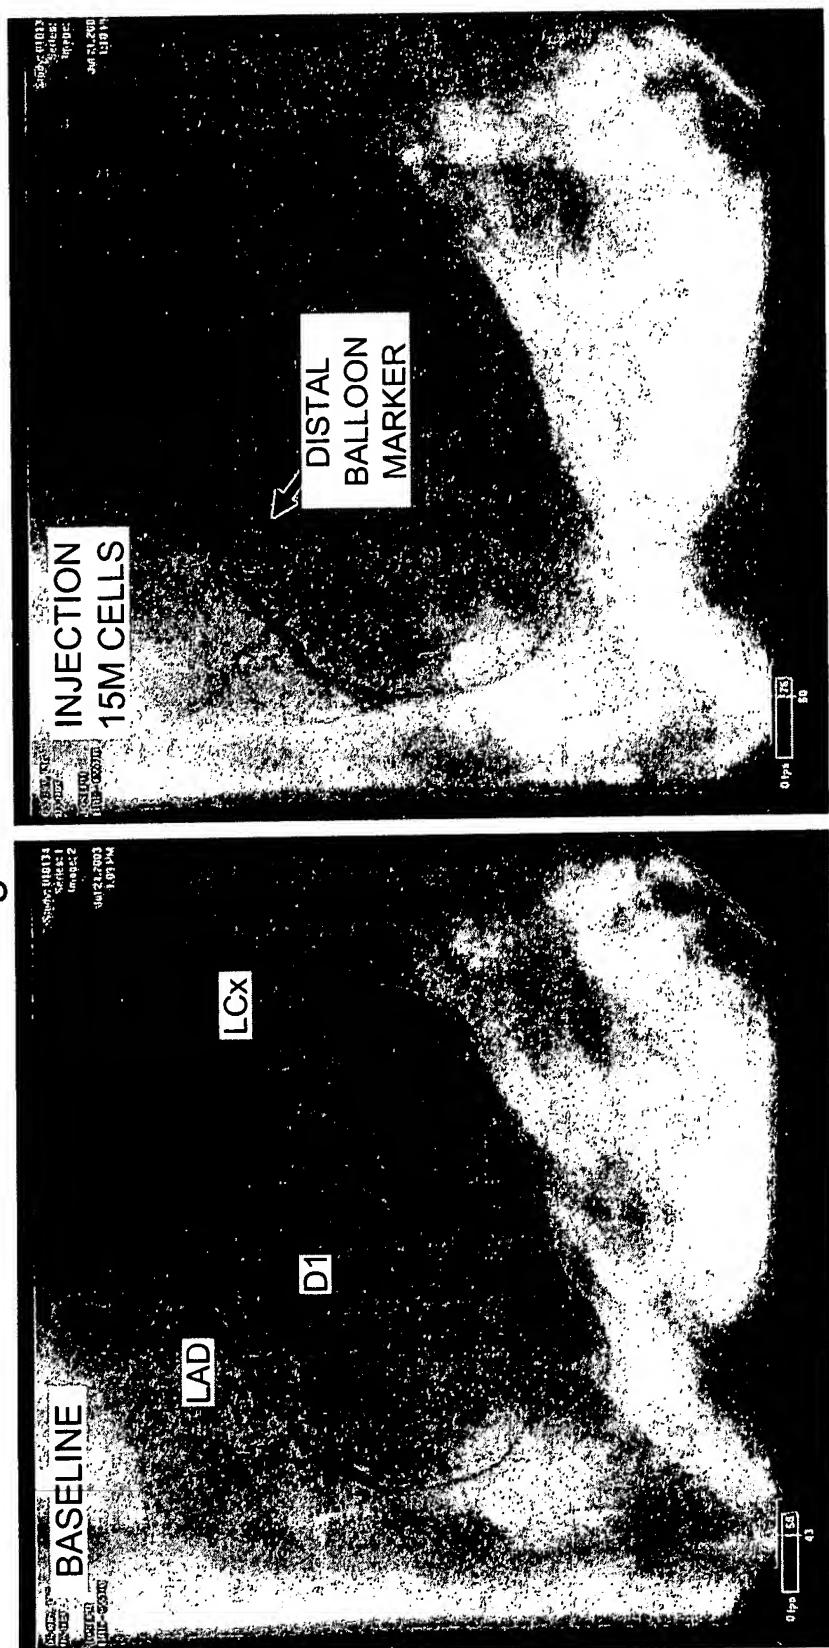

(18/20)